

Combo Harmonic Filter (Capacitor + Detuned Reactor)




HD -VAR + Detuned Series Reactor

	QN at 480			7%	
Effective kVAr@440V	7%	MFD X 3	In (A) at 480V	L	I
10	11.06	50.95	13.30	4.610	14.43
12.5	13.83	63.69	16.64	3.710	18.04
15	16.59	76.42	19.96	3.090	21.65
25	27.65	127.37	33.26	1.850	36.08

	QN at 525			7%	
Effective kVAr@440V	7%	MFD X 3	In (A) at 525V	L	I
10	13.23	50.95	14.55	4.610	14.43
12.5	16.54	63.69	18.19	3.710	18.04
15	19.85	76.42	21.83	3.090	21.65
25	33.08	127.37	36.38	1.850	36.08


BOX -VAR + Detuned Series Reactor

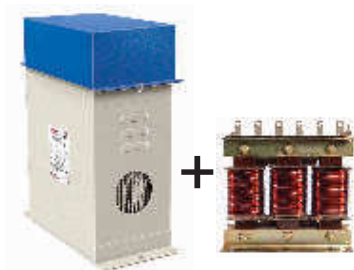

	QN at 480			7%	
Effective kVAr@440V	7%	MFD X 3	In (A) at 480V	L	I
10	11.06	50.95	13.30	4.610	14.43
12.5	13.83	63.69	16.64	3.710	18.04
15	16.59	76.42	19.96	3.090	21.65
25	27.65	127.37	33.26	1.850	36.08
50	55.30	254.75	66.52	0.920	72.16

	QN at 525			7%	
Effective kVAr@440V	7%	MFD X 3	In (A) at 480V	L	I
10	13.23	50.95	14.55	4.610	14.43
12.5	16.54	63.69	18.19	3.710	18.04
15	19.85	76.42	21.83	3.090	21.65
25	33.08	127.37	36.38	1.850	36.08
50	66.15	254.75	72.75	0.920	72.16

APP + Detuned Series Reactor

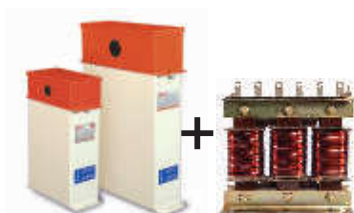

	QN at 480			7%	
Effective kVAr@440V	7%	MFD X 3	In (A) at 480V	L	I
10	11.06	50.95	13.30	4.610	14.43
12.5	13.83	63.69	16.64	3.710	18.04
15	16.59	76.42	19.96	3.090	21.65
25	27.65	127.37	33.26	1.850	36.08

	QN at 525			7%	
Effective kVAr@440V	7%	MFD X 3	In (A) at 525V	L	I
10	13.23	50.95	14.55	4.610	14.43
12.5	16.54	63.69	18.19	3.710	18.04
15	19.85	76.42	21.83	3.090	21.65
25	33.08	127.37	36.38	1.850	36.08